


# Computational Modeling of Pulverized Coal Fired Boilers



**Vivek V. Ranade**  
**Devkumar F. Gupta**

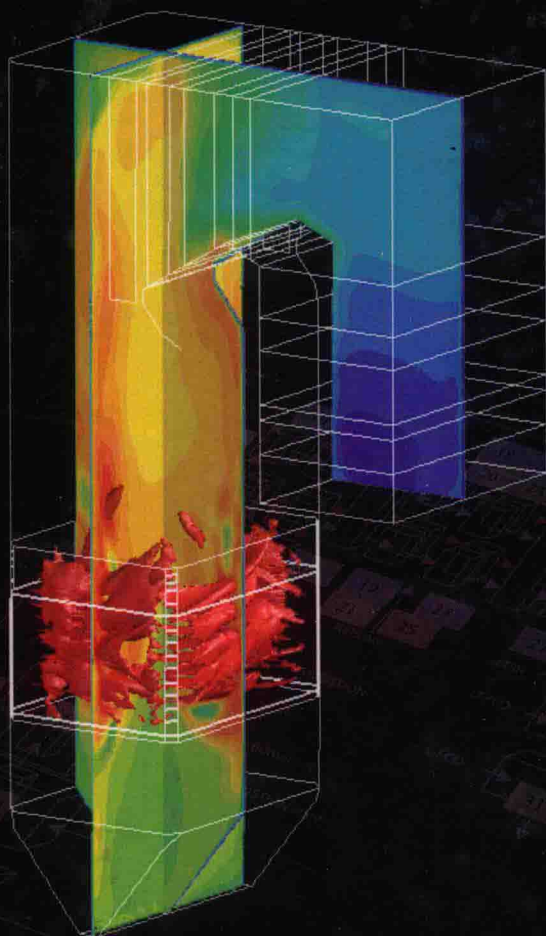

**CRC Press**  
Taylor & Francis Group

# **Computational Modeling of Pulverized Coal Fired Boilers**

**Vivek V. Ranade  
Devkumar F. Gupta**



**CRC Press**

Taylor & Francis Group

Boca Raton London New York

---

CRC Press is an imprint of the  
Taylor & Francis Group, an **informa** business

MATLAB® is a trademark of The MathWorks, Inc. and is used with permission. The MathWorks does not warrant the accuracy of the text or exercises in this book. This book's use or discussion of MATLAB® software or related products does not constitute endorsement or sponsorship by The MathWorks of a particular pedagogical approach or particular use of the MATLAB® software.

CRC Press  
Taylor & Francis Group  
6000 Broken Sound Parkway NW, Suite 300  
Boca Raton, FL 33487-2742

© 2015 by Taylor & Francis Group, LLC  
CRC Press is an imprint of Taylor & Francis Group, an Informa business

No claim to original U.S. Government works

Printed on acid-free paper  
Version Date: 20140929

International Standard Book Number-13: 978-1-4822-1528-1 (Hardback)

This book contains information obtained from authentic and highly regarded sources. Reasonable efforts have been made to publish reliable data and information, but the author and publisher cannot assume responsibility for the validity of all materials or the consequences of their use. The authors and publishers have attempted to trace the copyright holders of all material reproduced in this publication and apologize to copyright holders if permission to publish in this form has not been obtained. If any copyright material has not been acknowledged please write and let us know so we may rectify in any future reprint.

Except as permitted under U.S. Copyright Law, no part of this book may be reprinted, reproduced, transmitted, or utilized in any form by any electronic, mechanical, or other means, now known or hereafter invented, including photocopying, microfilming, and recording, or in any information storage or retrieval system, without written permission from the publishers.

For permission to photocopy or use material electronically from this work, please access [www.copyright.com](http://www.copyright.com) (<http://www.copyright.com/>) or contact the Copyright Clearance Center, Inc. (CCC), 222 Rosewood Drive, Danvers, MA 01923, 978-750-8400. CCC is a not-for-profit organization that provides licenses and registration for a variety of users. For organizations that have been granted a photocopy license by the CCC, a separate system of payment has been arranged.

**Trademark Notice:** Product or corporate names may be trademarks or registered trademarks, and are used only for identification and explanation without intent to infringe.

Visit the Taylor & Francis Web site at  
<http://www.taylorandfrancis.com>

and the CRC Press Web site at  
<http://www.crcpress.com>

# **Computational Modeling of Pulverized Coal Fired Boilers**

---

## *Preface*

---

Pulverized coal fired boilers have been and will be the mainstay of coal-based power generation worldwide. Such pulverized coal boilers are complex chemical reactors comprising many processes such as gas-solid flows, combustion, heat transfer (conduction, convection, and radiation), and phase change simultaneously. Conventional pulverized coal fired boiler designs have been continuously improved upon and even today new combustion technologies are being developed. Improving the efficiency of pulverized coal (PC) fired boilers has been the focus of considerable efforts by the utility industry since it leads to several benefits (reduced emissions and consumption of coal per MWe). Typically, a one percent improvement in overall efficiency can result in a nearly three percent reduction in CO<sub>2</sub> emission.

Efficiency of these PC boilers depends on several issues such as flow and mixing, inter-phase and intra-particle heat and mass transfer, and homogeneous and heterogeneous reactions. Some specific issues are critical in determining overall efficiency of such boilers. These are coal composition (proximate and ultimate analysis), characteristics of pulverized coal particles (shape and size distributions), reactivity of coal (devolatilization and combustion kinetics of coal), boiler design and configuration (size and shape of combustion chamber, burner design, number and locations of burners), excess air used, mixing of air and coal, flow mal-distribution, generation of fly and bottom ash particles, radiative heat transfer, heat recovery, and so on. Any efforts in improving the effective operating efficiency of these boilers therefore rest on fundamental understanding and control of the underlying flow, mixing, heat transfer, and reactions.

Computational modeling offers an excellent way to develop such fundamental understanding and to develop an ability to optimize boiler performance. However, through our interactions with industry, we realized that there is insufficient help available to practicing engineers for harnessing state-of-the-art computational modeling tools for complex, industrial boiler-like applications. Many boiler engineers either consider the complexities of industrial PC boilers impossible to simulate or expect miracles from off-the-shelf, commercial modeling tools. These two diverse views arise because of inadequate understanding about the role, state of the art, and possible limitations of computational modeling.

This book is aimed at filling this gap and providing a detailed account of the methodology of computational modeling of pulverized coal boilers. The book attempts to develop and discuss an appropriate approach to model complex processes occurring in PC boilers in a tractable way. The scope is restricted to the combustion side of the boiler. The rest of the components of PC boilers are outside the scope. Even for the combustion side, the scope is

restricted to the burner/excess air entry points to the exit of flue gases (and fly ash) from the heat recovery section. Milling and conveying of coal particles as well as further processing of flue gas beyond heat recovery sections (electro-static precipitators and so on) are beyond the scope of the present work. We have written this book with an intention to describe the individual aspects of combustion and heat recovery sections of PC boilers in a coherent fashion that may be useful to further improve design methodologies and optimize boiler performance. The intended users of this book are practicing engineers working in utility industries and in boiler design companies, as industrial consultants, in R & D laboratories, as well as engineering scientists/research students. Some prior background of reaction engineering and numerical techniques is assumed.

The information in the book is organized in mainly six chapters: the first chapter provides a general introduction. The second chapter discusses the overall approach and methodology. Kinetics of coal pyrolysis (devolatilization) and combustion and methods of its evaluation are discussed in Chapter 3. Computational flow modeling is discussed in Chapter 4. This chapter covers modeling aspects from the formulation of model equations to simulation methodology. Typical results obtained with computational flow models are also discussed in this chapter. Computational flow models provide a framework for developing a deeper understanding of the underlying processes in PC boilers. These models also provide a quantitative relationship between boiler hardware and operating protocols with boiler performance and efficiency. Phenomenological models or reactor network models are discussed in Chapter 5. These models require significantly less computational resources than computational flow models and therefore can be used for boiler optimization. A brief discussion on practical applications of computational modeling is included in Chapter 6. An attempt is made here to provide specific comments to connect modeling with real-life applications. Key points are summarized in the last chapter (Chapter 7) along with some comments about the path forward.

Though many of the examples are for the older generation 210 MWe boiler, we have made an attempt to evolve general guidelines that will be useful for solving practical problems related to current and future generations of PC boilers. The material presented here can be extended to model larger boilers based on conventional, super-critical, or ultra-super-critical technologies as well as based on oxy-fuel technologies. The material included in this book may be used in several ways: as a basic resource of methodologies or in making decisions about applications of computational modeling in practice. The content could be useful as a study material for an in-house course on pulverized coal boilers, for example, design and optimization or a companion book while solving practical boiler-related problems. We hope that this book will encourage chemical engineers to exploit the potential of computational models for better engineering of pulverized coal boilers.

We are grateful to many of our associates and collaborators with whom we worked on different industrial projects. Many of VVR's students have contributed to this book in different ways. Particularly, Ankit Jain, Akshay Singan, Ajinkya Pandit, Deepankar Sharma, and Dhananjay Mote read the early drafts of manuscript and provided useful suggestions from a student's perspective. Vinayak Ranade, Nanda Ranade, and Maya Gupta also read the early drafts and suggested ways to improve overall readability. The manuscript was improved wherever their suggestions were incorporated. Any remaining errors or shortcomings are, needless to say, the responsibility of the authors. We also wish to thank the editorial team at CRC Press, particularly Dr. Gagandeep Singh, for their patience and help during the process of writing this book.

Besides the professional associates, VVR would like to acknowledge his wife Nanda and daughter Vishakha, and DFG would like to acknowledge his wife Maya and daughters Suhani and Anjani for their understanding and enthusiastic support all along.

**Vivek V. Ranade**

**Devkumar F. Gupta**

*Pune, India*

---

## About the Authors

---

**Vivek V. Ranade** is a deputy director of CSIR-National Chemical Laboratory, Pune, India ([www.ncl-india.org](http://www.ncl-india.org)) and leads chemical engineering and process development research. His research interests include process intensification, reactor engineering, and multiphase flows. He has successfully developed solutions for enhancing the performance of a wide range of industrial processes and has facilitated their implementation in practice. He has also developed various devices (micro-reactors, filters, vortex diodes) and products, and has published more than 120 papers and 3 books. Dr. Ranade is a recipient of several awards, including the Shanti Swarup Bhatnagar award and the DST Swarna Jayanti Fellowship. He is a fellow of the Indian National Academy of Engineering and the Indian Academy of Sciences. He is also an entrepreneur and co-founded a company, Tridiagonal Solutions ([www.tridiagonal.com](http://www.tridiagonal.com)). He is currently leading a large program on process intensification, titled Indus MAGIC ([www.indusmagic.org](http://www.indusmagic.org)), which is aimed at developing MAGIC (modular, agile, intensified, and continuous) processes and plants. He holds B.Chem.Eng. (1984) and PhD (1988) degrees from the University of Mumbai (UDCT), India.

**Devkumar F. Gupta** is currently a principal scientist at Thermax Limited, Pune, India. His research interest lies in converting solid fuels into high-value-added products using fluidized bed reactors. He has been actively involved and had an instrumental role in the design, computational modeling, and establishment of high-pressure gasification demonstration plants in India. He has worked jointly with utility industries to develop computational fluid dynamics (CFD) and reduced order numerical models for pulverized coal fired boilers. He has presented several research papers at international and national conferences on clean coal technology. He holds a PhD (2011) in chemical engineering from the University of Pune.



---

# Contents

---

Preface.....ix

About the Authors ..... xiii

**1. Introduction..... 1**

    1.1 Coal Fired Boilers..... 6

    1.2 Computational Modeling..... 13

    1.3 Organization of the Book..... 15

    References ..... 17

**2. Toward the Computational Modeling of Pulverized Coal Fired Boilers ..... 19**

    2.1 Overall Approach..... 21

    2.2 Engineering Design Models ..... 23

    2.3 Particle-Level Models ..... 24

    2.4 Boiler-Level Models ..... 26

        2.4.1 Computational Fluid Dynamics (CFD) Models..... 27

        2.4.2 Reactor Network Models ..... 28

    2.5 Applying Computational Models to Practice ..... 29

    2.6 Summary ..... 30

    References ..... 30

**3. Kinetics of Coal Devolatilization and Combustion: Thermogravimetric Analysis (TGA) and Drop-Tube Furnace (DTF)..... 33**

    3.1 Coal Devolatilization and Combustion ..... 37

    3.2 Coal Characterization Using Thermogravimetric Analysis (TGA)..... 45

        3.2.1 Typical Example of a TGA Experiment ..... 46

        3.2.2 Processing TGA Data ..... 47

    3.3 Coal Characterization Using the Drop-Tube Furnace (DTF)..... 53

        3.3.1 Typical Example of a DTF Experiment ..... 54

        3.3.2 Processing DTF Data ..... 55

            3.3.2.1 CFD Model Equations ..... 59

            3.3.2.2 Boundary Conditions and Numerical Simulation..... 67

            3.3.2.3 Application of CFD Models to Simulate DTF Data..... 68

    3.4 Summary and Conclusions ..... 74

    References ..... 75

<b>4. CFD Model of a Pulverized Coal Fired Boiler .....</b>	<b>81</b>
4.1 Formulation of CFD Model of a PC Fired Boiler .....	82
4.1.1 Overall Continuity and Momentum Balance Equations.....	84
4.1.2 Species Balance Equations.....	92
4.1.3 Energy Balance Equations.....	97
4.1.3.1 P-1 Radiation Model.....	101
4.1.3.2 Discrete Ordinate (DO) Radiation Model.....	102
4.1.4 Formation of NO <sub>x</sub> and SO <sub>x</sub> .....	110
4.1.5 Particle Deposition on Walls and Heat Transfer through the Deposit Layer.....	113
4.2 CFD Simulations of a PC Fired Boiler.....	118
4.2.1 Numerical Simulation and Simplifying the Geometry of PC Fired Boilers .....	119
4.2.1.1 Grid Generation for a PC Fired Boiler.....	121
4.2.1.2 Characteristics of Porous Block Representing Internal Heat Exchangers .....	122
4.2.2 Simulation of Cold Air Velocity Tests (CAVTs) .....	127
4.2.3 Simulation of a Typical 210-MWe High-Ash Coal Fired Boiler .....	127
4.2.3.1 Gas Flow .....	131
4.2.3.2 Particle Trajectories .....	132
4.2.3.3 Temperature Distribution .....	133
4.2.3.4 Species Profile .....	135
4.2.3.5 Heat Transfer to Heat Exchangers .....	136
4.2.3.6 Characteristics of the Crossover Pass.....	137
4.2.4 Influence of Operating Parameters on Boiler Performance.....	139
4.2.4.1 Excess Air (i.e., Fuel/Air Ratio).....	143
4.2.4.2 Burner Tilt .....	145
4.2.4.3 Effect of Boiler Load.....	151
4.2.4.4 Coal Blends.....	152
4.3 Summary and Conclusions .....	155
References .....	157
 <b>5. Reactor Network Model (RNM) of a Pulverized Coal Fired Boiler.....</b>	<b>165</b>
5.1 Approach to Develop Reactor Network Models .....	166
5.2 Formulation of Reactor Network Models from CFD Simulations .....	168
5.2.1 Formulation of Reactors/Zones in a PC Fired Boiler .....	168
5.2.2 Formulation of Reactor Network from the Identified Zones.....	177
5.3 Model Equations and Solution.....	183
5.3.1 Continuous Phase .....	184

5.3.2	Discrete Phase .....	186
5.3.2.1	Particle Mass Balance .....	186
5.3.2.2	Particle Energy Balance.....	189
5.3.3	Homogenous Gas-Phase Reactions.....	190
5.3.4	Radiation .....	192
5.3.5	Solution of Model Equations .....	193
5.4	Application of the RNM to a Typical 210-MWe PC Fired Boiler	196
5.5	Summary and Conclusions .....	204
	References .....	205
<b>6.</b>	<b>Application to Practice.....</b>	<b>207</b>
6.1	Performance Enhancement Using Computational Models .....	207
6.2	Application of CFD Models to PC Fired Boilers.....	208
6.2.1	Formulation of CFD Models.....	209
6.2.1.1	Selection of a Solution Domain .....	209
6.2.1.2	Geometry Modeling and Mesh Generation .....	210
6.2.1.3	Formulation of Boundary Conditions.....	212
6.2.1.4	Specifying Physical Properties.....	215
6.2.1.5	Turbulence and Two-Phase Models.....	216
6.2.1.6	Chemical Reactions.....	216
6.2.1.7	Heat Transfer.....	217
6.2.2	Solution of Model Equations .....	218
6.2.3	Examination and Interpretation of Simulated Results.....	221
6.2.4	Application of Simulated Results for Performance Enhancement.....	223
6.3	Application of Reactor Network Models to PC Fired Boilers.....	227
6.4	Common Pitfalls in Computational Modeling .....	229
6.5	Summary .....	232
	References .....	234
<b>7.</b>	<b>Summary and the Path Forward.....</b>	<b>237</b>
	<b>Notations .....</b>	<b>243</b>
	<b>Index .....</b>	<b>249</b>

# 1

## *Introduction*

---

Pulverized coal (PC) fired boilers have been the mainstay of coal-based power generation worldwide for almost 100 years. This is not surprising as coal is the most abundant and widely distributed fossil fuel, with global reserves of about 1,000 billion tons (IEA, 2010a). Coal fuels more than 40% of the world's electricity. The percentage of coal-based electricity is much higher in some countries, such as South Africa (93%), Poland (92%), China (79%), Australia (78%), Kazakhstan (75%), and India (69%). The growing needs of developing countries are likely to ensure that coal remains a major source of electricity in the foreseeable future despite climate change policies (IEA, 2010 a, b).

Electricity generation from coal appears to be a rather simple process. In most coal-fired power plants, coal is first milled to a fine powder (pulverized coal). Fine particles of coal have more surface area and therefore burn more effectively. In these systems, called pulverized coal (PC) combustion systems, the powdered coal is fed to the combustion chamber of a boiler. Coal particles burn in this chamber and generate a fireball (high-temperature zone) and hot gases. The energy released in radiative and convective form is used to convert water (flowing through the tubes lining the boiler walls) into steam. The high-pressure steam is passed into a turbine, causing the turbine shaft to rotate at high speed. A generator is mounted at one end of the turbine shaft where electricity is generated (via rotating coils in a strong magnetic field). The steam exiting from the turbines condenses, and the condensed water is recycled to the boiler to be used once again. A schematic of a typical PC fired boiler is shown in Figure 1.1.

The PC fired systems were developed in the 1920s. This process brought advantages that included a higher combustion temperature, improved thermal efficiency, and a lower requirement of excess air for combustion. Improvements continue to be made in conventional PC fired power station design, and new combustion technologies are being developed. The focus of considerable efforts by the coal industry has been on improving the efficiency of PC fired power plants. Increasing the efficiency offers several benefits (Burnard and Bhattacharya, 2011):

- Lower coal consumption per megawatt (MW) (i.e., resource preservation)
- Reduced emission of pollutants (e.g., SO<sub>x</sub> [sulfur oxides], NO<sub>x</sub> [nitrogen oxides], etc.)

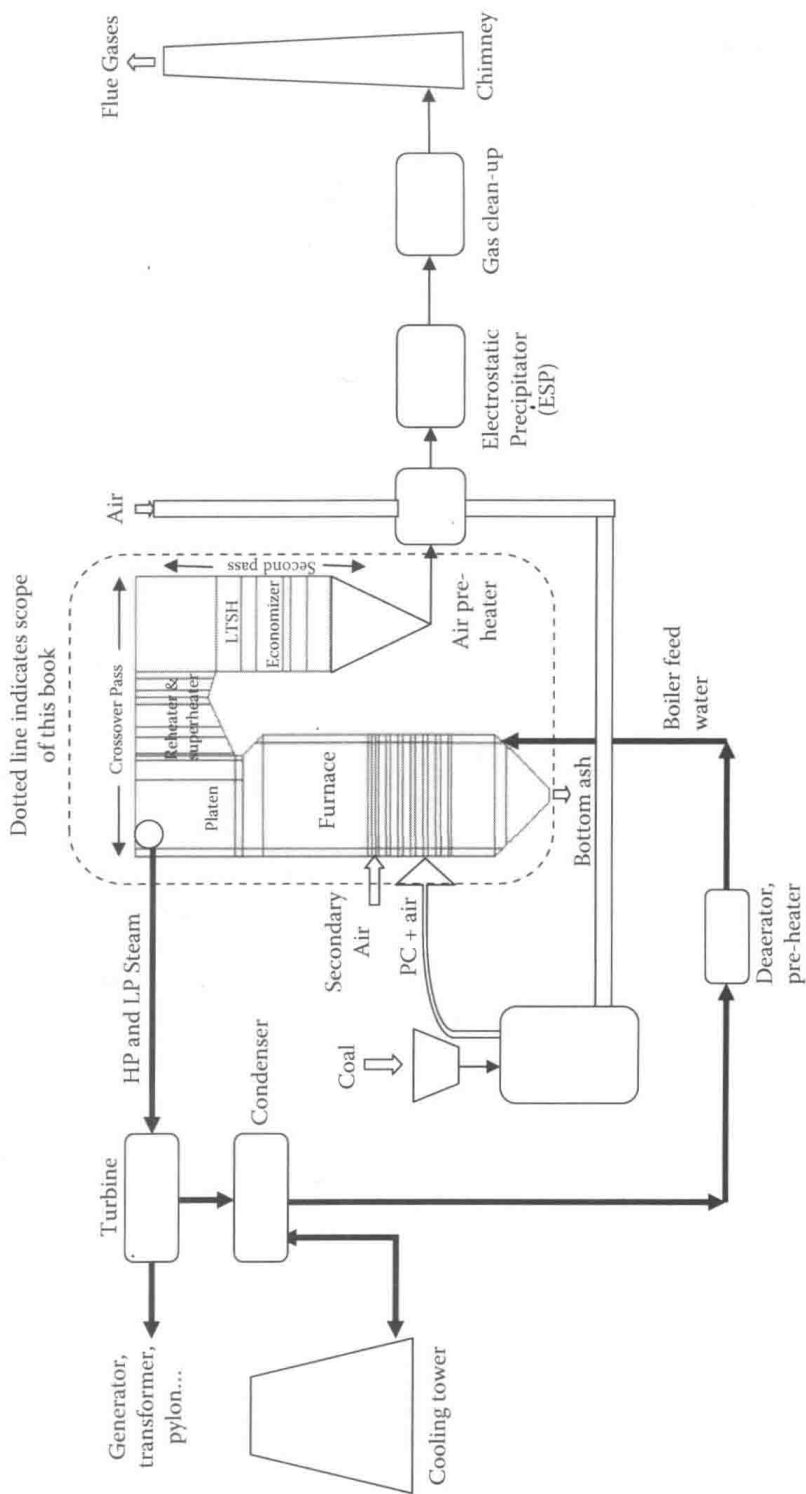


FIGURE 1.1

Schematic of typical pulverized coal fired power plant and scope of this book.

- Reduced CO<sub>2</sub> emission (greenhouse gas): a one percentage-point improvement in overall efficiency can result in ~3% reduction in CO<sub>2</sub> emissions
- Existing power plant efficiencies in developing countries are generally lower. The coal use in these countries for electricity generation is increasing. The improvements in efficiencies of PC fired boilers will therefore have a significant impact on resource conservation and reduction in emissions of CO<sub>2</sub> per megawatt (MW). There is a huge scope for achieving significant efficiency improvements as the existing fleet of power plants is replaced over the next 10 to 20 years.

In recent years, considerable progress has been made in the development of more efficient coal-based systems such as supercritical (SC) and ultra-supercritical (USC) steam cycles. These also include systems based on coal gasification (such as IGCC: integrated gasification combined cycle). However, while there are several proposals for further commercial demonstrations of IGCC and some are being constructed, PC combustion-based plants continue to dominate new plant orders. It may be possible that IGCC will penetrate the market on a large scale only where the co-production of power and chemicals can be economically demonstrated.

Considering the dominance of PC fired systems for electricity generation, several efforts have been made to enhance the overall efficiencies of these systems. The efficiency of a PC fired boiler depends on a variety of factors:

- Plant design (milling, burner, heat recovery systems, and so on)
- Operating conditions (pressure/steam conditions)
- Quality of coal
- Turbine efficiencies
- Ambient conditions
- Operating protocols
- Maintenance practices

In this book we restrict the scope of our discussions to the combustion side of the boiler. The components of the PC fired boiler other than the combustion side are outside the scope of this book. Even for the combustion side, the scope is restricted: from burner/excess air entry points to the exit of flue gases (and fly ash) from the heat recovery section. The milling and conveying of coal particles, as well as further processing of flue gas beyond the heat recovery section (electrostatic precipitators, etc.), are beyond the scope of the present work. The scope of this book is clearly marked over a schematic of a power plant shown in Figure 1.1. Therefore, in the context of this book, PC boiler and PC boiler efficiency essentially refer to the combustion chamber of the PC fired boiler and thermal efficiency, unless stated otherwise.

Several developments on higher-temperature (and -pressure) systems—namely, SC and USC pulverized coal fired boilers—have been realized in recent years (or are being realized). While sub-critical plants achieve overall efficiencies of 32% to 38% (on an LHV [lower heating value] basis), state-of-the-art USC boilers are expected to realize overall efficiencies of 42% to 45% (LHV basis). Single-unit capacities of these plants have reached 1,100 MWe (megawatt electrical). Parallel developments are also being made in oxy-fuel technologies to facilitate CO<sub>2</sub> capture. Efforts have been made to reduce other emissions, such as NO<sub>x</sub>, SO<sub>x</sub>, and particulates. Significant research is being done in areas such as new emission control technologies, state-of-the-art boiler designs, and low-temperature heat recovery systems for improved plant efficiencies; systems for improved ash disposability and reduced waste generation; and optimum system integration and plant controls. These research areas are still reinventing themselves.

Key components of efficiency improvement initiatives depend on a better understanding of the burning of coal and subsequent heat transfer for converting water into steam. The overall performance of the boiler critically depends on our understanding as well as our ability to manipulate the following key processes:

- Gas-solid flow (through ducts, burner nozzles, combustion chamber, heat recovery systems, electrostatic precipitators, etc.):
  - Gas: air/flue gas
  - Particles: coal/ash
- Combustion:
  - Volatile combustion
  - Char combustion
  - Pollutant formation and role of furnace aerodynamics
- Radiative and convective heat transfer

Technology advancements in PC fired boilers require a thorough and quantitative understanding of these aspects. Anyone interested in enhancing boiler performance will want to establish quantitative relationships among fuel (coal) characteristics, hardware design of boiler, and operating protocols with boiler efficiency. Such a quantitative relationship can then be used to optimize fuel mix and design as well as operating practices. Computational modeling, particularly computational flow modeling (CFM), plays a crucial role in developing such an understanding as does the ability to tailor the design and operating protocol to enhance overall performance.

Over the years, computational fluid dynamics (CFD) tools have evolved as powerful design and predictive tools to simulate complex equipment (Ranade, 2002). Computational fluid dynamics (CFD) is a body of knowledge and techniques to solve mathematical models (primarily based on conservation of mass, momentum, and energy) on digital computers. The development of high-performance computers, advances in the physics of fluids, and advances in numerical techniques and algorithms has made it increasingly possible to use CFD models for complex reacting systems such as PC fired boilers. It is, however, necessary to adapt CFD techniques and develop an appropriate CFM approach for meaningfully applying them to complex systems like PC fired boilers.

This book is written with the intention of assisting practicing engineers and researchers in developing such an approach. It describes the methodology to formulate a CFD model for simulating PC fired boilers. Although most of the results included here are for an old-generation 210-MWe unit, the methodology can be extended in a straightforward way to model advanced supercritical, ultra-supercritical, and oxy-fuel combustion systems.

CFD models/simulations of PC fired boilers are usually computationally expensive and time consuming. Therefore, even if these models/simulations provide extensive insight into processes occurring in PC fired boilers, they are not very suitable for real-time optimization (which requires much quicker response times). A complementary approach called reactor network modeling (RNM) is therefore developed and presented in this book. The RNMs are essentially lower-order computational models (typically with a few hundred variables, in contrast to a few million or more variables used in CFD models) that can be used for overall optimization and even for real-time process control. The methodology and process of developing an RNM based on data extracted from detailed CFD models of PC fired boilers are discussed here. Efforts are made to provide guidelines for

- Characterizing coal using a drop-tube furnace and a thermogravimetric analyzer (TGA)
- CFD modeling of a PC fired boiler
- Developing reactor network models (RNMs)
- Applying computational models to industrial practice

The presented results and discussion will also provide insight into the complex processes occurring in PC fired boilers. The basic information and key issues of coal fired boilers are discussed in Section 1.1. Key aspects of CFM with reference to potential application to coal fired boilers are then discussed in Section 1.2, and the organization of the book is briefly discussed in Section 1.3.



## 1.1 Coal Fired Boilers

Worldwide, coal fired generating capacity is expected to reach approximately 2,500 GW (gigawatt) by the end of 2020. This is an increase of nearly 60% since 2008, and more than 55% of the projected new generating capacity is expected to be in Asia (McIlvaine, 2009). The capacity enhancement is based on the addition of advanced low-emission boiler systems. Continuing efforts are also being made on existing power plants to achieve higher efficiency, reliability, and availability with low maintenance, while complying with stringent emissions regulations for CO<sub>2</sub>, SO<sub>x</sub>, NO<sub>x</sub>, and particulates. Coal fired boilers have undergone major innovations in order to satisfy both economics and increasing stringent environmental regulations. In principle, solid-fuel combustion technologies are divided into three categories:

1. Bed or grate combustion
2. Suspension or pulverized combustion
3. Fluidized bed combustion

The traveling grate stoker was the early coal combustion system for power generation. Traveling grate stokers are capable of burning coals over a wide range of coal rankings (from anthracite to lignite). The typical particle sizes are 1 to 5 cm (centimeter) with residence times of 3,000 to 5,000 s (second). The flame temperature is around 1,750K (Essenhigh, 1981). Stoker firing is not able to scale beyond 50-MWe unit capacities. The boiler efficiency gets suppressed by the high excess air (about 40%) that was required for acceptable coal burnout.

In 1946, Babcock and Wilcox introduced the cyclone furnace for use with slagging coal (i.e., coal that contains inorganic constituents that will form a liquid ash at temperatures of ~1,700K or lower); this was the most significant advance in coal firing since the introduction of pulverized coal firing (Miller, 2005). A cyclone furnace provides the benefits obtained with PC firing and also has the advantages of utilizing slagging coals and reducing costs due to less fuel preparation (i.e., fuel can be coarser and does not need to be pulverized). In slagging combustion, the boiler tubes in the lower part of the furnace are covered by a refractory to reduce heat extraction and to allow the combustion temperature to rise beyond the melting point of the ash. The temperature must be sufficiently high for the viscosity of the slag to be reduced to about 150 Poise, which is necessary for removal in liquid form. The most notable application of slagging combustion technology in the United States is the cyclone furnace, in which about 85% of the coal ash can be removed in molten form in a single pass without ash recirculation. Because of the high temperature and the oxidizing atmosphere, slagging furnaces produce very high NO<sub>x</sub> emissions and therefore fell into disfavor in the 1970s.