



Noise Control in Buildings

Fundamental and Applications

Mahavir Singh

Noise Control in Buildings

Fundamental and Applications

Mahavir Singh



Narosa Publishing House

New Delhi Chennai Mumbai Kolkata

Noise Control in Buildings

Fundamental and Applications

172 pgs. | 90 figs. | 26 tbls.

Mahavir Singh

Acoustics, Ultrasonics and Vibration Section

CSIR-National Physical Laboratory

New Delhi

Copyright © 2014, Narosa Publishing House Pvt. Ltd.

NAROSAPUBLISHINGHOUSEPVT.LTD.

22 Delhi Medical Association Road, Daryaganj, New Delhi 110 002

35-36 Grems Road, Thousand Lights, Chennai 600 006

306 Shiv Centre, Sector 17, Vashi, Navi Mumbai 400 703

2F-2G Shivam Chambers, 53 Syed Amir Ali Avenue, Kolkata 700 019

www.narosa.com

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording or otherwise, without prior written permission of the publisher.

All export rights for this book vest exclusively with Narosa Publishing House Pvt. Ltd.
Unauthorised export is a violation of terms of sale and is subject to legal action.

ISBN 978-81-8487-342-9

Published by N.K. Mehra for Narosa Publishing House Pvt. Ltd.,
22 Delhi Medical Association Road, Daryaganj, New Delhi 110 002

Printed in India

ACKNOWLEDGEMENTS

The author would like to acknowledge the support of the Acoustics Section, and particularly Dr. V. Mohanan, for their support over the years in the measurements of sound transmission through buildings, and for giving permission for extracts and results from unpublished technical reports to be included in this book.

The author would also like to acknowledge the support of the BPB India Gypsum and Lafarge Boral Gypsum India, for giving permission to include results from an unpublished technical report in Chapters 3 and 4.

Much of the basic work on the measurements of sound transmission in buildings has been funded by a series of research grants from BPB India Gypsum over a period of 18 years.

The author is grateful for the assistance of Dr. Omkar Sharma, who carried out much of the work for the Acoustics, Ultrasonics & Vibration Section under a series of research contracts, to Dr. Kirti Soni, who also supplied data and read through the manuscript and to Dr. Yudhisther Kumar who checked the final manuscript. Recent research data was also given by my research student, Mr. D. P. Singh, and Surjit Singh which enhanced the sections in Chapter 1 to 7.

Special thanks are also expressed to Prof. K. K. Pujara, IIT Delhi for giving fruitful suggestions in the review and correction of the entire text.

Mahavir Singh

PREFACE

Noise Control in Buildings contains a complete set of data on the properties of acoustical materials and on the sound insulation of walls and floor/ceiling constructions. This wealth of technical information provides an invaluable resource for the professional as well as the non-professional:

- The properties and selection of acoustical materials
- The design of select wall and floor/ceiling constructions
- Airborne sound insulation
- Control of noise communicated by building structures
- Acoustical characteristics of rooms

Also included are effective methods for dealing with noise problems in HVAC systems, plumbing systems, and machinery - plus innovations in techniques for the design of buildings with low noise levels.

Controlling noise in buildings is an important part of an architect's and engineer's responsibility. This book provides practical guidelines on avoiding noise problems during the design and construction of new buildings, and eliminating noise in existing structures. Noise control in buildings covers such topics as properties of sound absorptive materials, acoustical characteristics of rooms, airborne sound insulation, and structure-borne sound insulation. Included are proven methods- and technical data-for dealing with noise, HVAC systems, plumbing systems, and machinery, plus information on the design of buildings for noise control.

It provides a wealth of information, mainly without the use of mathematics that can be used to ensure that noise control measures are incorporated into buildings during the design stage. The reader will find introductory material on the general aspects of sound transmission into buildings, properties of sound waves, sound absorption coefficients, and tables of sound absorption coefficients.

It is pointed out in the preface that extensive tables of the sound absorptive properties of materials are not generally available in the literature, and that the characteristics of acoustical materials manufactured have been collected and published in Chapters 2, 3 and 4. Sound in Room, Developments in Noise Control and Sound Transmission through Building Elements respectively.

Mahavir Singh

CONTENTS

<i>Acknowledgements</i>	...v
<i>Preface</i>	...vii

1.	Basics of Noise Control	1
1.1	Introduction	1
1.2	Physical Properties of Sound	2
1.3	Filters and Spectra	4
1.4	Noise Criteria Contours	7
1.5	Standard Measurements for Building Acoustics	9
1.6	Sound Transmission Class	12
1.7	Fundamental Noise Control Procedures	14
2.	Sound in Rooms	19
2.1	Introduction	19
2.2	Basic Acoustical Principles	20
2.3	Noise Criteria for Rooms	25
2.4	Design of Rooms for Speech	26
2.5	Design of Open Offices	30
2.6	Appendix 2.1 Room Acoustics Equations	33
3.	Developments in Noise Control	37
3.1	Introduction	37
3.2	Sound Transmission through Block Walls	37
3.3	Increasing the STC of Block Walls	39

3.4	Summary of Findings and Recommendations	44
3.5	Plumbing Noise	45
3.6	Resilient Wrappings	46
3.7	Wall System Modifications	47
3.8	Combined Approach	48
3.9	Comparison of Pipe Materials	49
3.10	Conclusions	49
3.11	Flanking Noise	50
3.12	Noise Leaks	52
3.13	Electrical and other Wiring Outlets	52
3.14	Partition and Ceiling Spaces	53
3.15	Ceiling Treatment	55
3.16	Summary	59
4.	Sound Transmission Through Building Elements	61
4.1	Introduction	61
4.2	Specific Wall Designs	67
4.3	Windows	72
4.4	Doors	74
4.5	Floors	76
4.6	Summary	79
5.	Acoustics in Practice	81
5.1	Introduction	81
5.2	Criteria for Field Sound Transmission Class and Field Impact Insulation Class	81
5.3	Building Layout	82
5.4	Multi-element Transmission	85
5.5	Flanking Paths	87
5.6	Flanking Sound Transmission in Office Plenums	89
5.7	Construction Details	90
5.8	Plumbing Noise	94
5.9	Summary	96
6.	Room Acoustics	99
6.1	Introduction	99
6.2	Loudspeaker Directivity and Room Response	101
6.3	Room Reverberation Time T_{60}	103
6.4	Loudspeaker and Listener Placement	110

7.	Acoustics and Design	115
7.1	Introduction	115
7.2	Basic Acoustic Terminology	116
7.3	Noise Sources	117
7.4	Design Criteria	118
7.5	Assessment of Room Sound Level	119
7.6	Control of Noise	120
7.7	Example of Design Considerations: Hotels	122
7.8	Example of Design Considerations: Offices	122
7.9	Room Acoustics	128
7.10	Reverberant Noise Control in Rooms	133
7.11	Reduction of Reverberant Sound Level	135
7.12	Conclusions	139
8.	Questions and Answers	141
	<i>References</i>	151
	<i>Index</i>	155

BASICS OF NOISE CONTROL

1.1 INTRODUCTION

Sound is a pervasive phenomenon and such factors as the high density of new residential construction and the use of high powered equipment in modern lightweight construction systems are leading to higher noise levels in our homes, our work spaces and generally everywhere in our cities. In fact, surveys done in the United States report that the noise level of major cities is rising at the rate of approximately one decibel per year. We can no longer ignore the trend.

While the general field of noise control is quite broad, the Insight program was limited to noise control in buildings; however, the principles of noise control are the same regardless of the environment being considered.

Inadequate noise control has often made a restaurant meal an unpleasant experience. High noise levels in the workplace are distracting and irritating, possibly resulting in higher absenteeism and loss of productivity. Inadequate acoustical privacy is common in office buildings. Conference rooms, despite the fact that their primary purpose is speech communication, are often excessively reverberant and noisy, making it difficult to understand speech from people only a short distance away. Most schools, churches, gymnasiums and swimming pools, as they now exist, could benefit from an acoustical tune-up, improving the quality of their indoor environment and their revenue-earning potential.

A recent survey in Vancouver found about 40% of the tenants in several multi-family dwelling projects dissatisfied with the degree of acoustical

privacy in their homes. This was the major problem as far as the tenants were concerned, and it is a major complaint in many of our new apartment and condominium projects.

Elsewhere, in a large hotel in India, the acoustical engineers were overruled by the project designers; in order to save some ₹ 3.7 crores they provided bedrooms with single glazing and operable sashes for ventilation. When the hotel came into service, most of the rooms had so much traffic noise penetrating, that they were unusable for sleeping. To rectify the situation, the hotel had to install double glazing and air conditioning at a cost of ₹ 9.6 crores, not including the loss of revenue and general disturbance during the repair work.

Such errors are inexcusable, given that the knowledge exists to design and build quality acoustical environments.

The essence of this Insight program is a discussion of the principles of noise control in buildings. The fundamentals of sound are explained in the first paper, followed by the criteria and methods to control noise within rooms, in the second paper. The third paper examines the issue of noise reduction across walls, floors, windows and doors, and the last paper deals with acoustics of buildings, with an emphasis on machine and plumbing noises and the annoying problem of flanking noise.

1.2 PHYSICAL PROPERTIES OF SOUND


The material in this section gives a brief introduction to some of the terms used in building acoustics and the test methods used to characterize systems and materials. A very basic understanding of some fundamentals of acoustics and terms used in building acoustics, is all that is necessary to understand the material in this and the following chapters. To emphasize the simplicity of the approach, equations are kept to a minimum.

Sound is generated by creating a disturbance of the air, which sets up a series of pressure waves fluctuating above and below the air's normal atmospheric pressure, much as a stone that falls in water generates expanding ripples on the surface. Unlike the water waves, however, these pressure waves propagate in all directions from the source of the sound. Our ears sense these pressure fluctuations, convert them to electrical impulses, and send them to our brain, where they are interpreted as sound.

There are many sources of sound in buildings: voices, human activities, external noises such as traffic, entertainment devices and machinery. They all generate small rapid variations in pressure about the static atmospheric pressure; these propagate through the air as sound waves.

As well as travelling in air, sound can travel as vibrational waves in solids or liquids. The terms airborne and structure-borne sound are used depending on which medium the sound is travelling in at the time. For example, the noise from a radio set may begin as airborne sound, enter the structure of the building and travel for some distance as structure-borne sound, and then be radiated again as airborne sound in another place. The importance of structure-borne sound will become more apparent when flanking sound transmission is shown in Figure 1.1.

Air pressure is usually measured in units of Pascals (Pa). Atmospheric pressure is about 100 kPa. Sound pressure is a measure of the fluctuation of the air pressure above and below normal atmospheric pressure as the sound waves propagate past a listener.

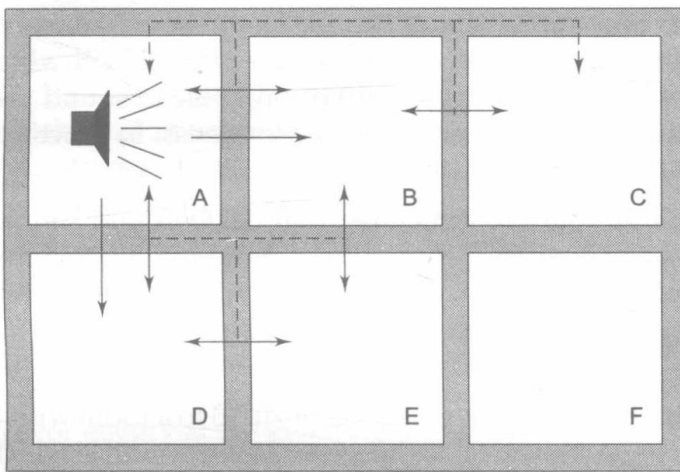

AIRBORNE AND STRUCTURE-BORNE SOUND

Figure 1.1

The pressure variations in an individual sound wave are much less than the static atmospheric pressure, but the range of sound pressures encountered in acoustics is very large. The threshold of hearing is assumed to correspond to pressure fluctuations of 20 Micro Pascals; some individuals will have more acute hearing than this, some less. The threshold of pain in the ear corresponds to pressure fluctuations of about 200 Pa. This second value is ten million times the first. These unwieldy numbers are converted to more convenient ones using a logarithmic scale, the decibel scale. Sound pressure levels are expressed as a number followed by the symbol dB. Sound level meters convert electrical signals from a microphone to sound pressure levels in dB. Table 1.1 gives some representative sound pressure levels encountered in a range of situations.

Table 1.1: Typical Sound Levels

Jet takeoff, artillery fire, riveting	120 or more
Rock band or very loud orchestra	100 – 120
Unruffled truck, police whistle	80 – 100
Average radio or TV	70 – 90
Human voice at 1 m	55 – 60
Background in private office	35 – 40
Quiet home	25 – 35
Threshold of hearing	20

Decibels are more easily related to the response of the human ear, which also responds logarithmically to sound. The response of our ears, that is, our perception of loudness, does not increase linearly with a linear increase in sound pressure. For example, a 10 dB increase in sound pressure level would be perceived as a doubling of the loudness. In practical situations, level changes of about 3 dB are just noticeable.

It is very important to remember that decibels and similar acoustical quantities have properties different from more conventional units. Sound pressure levels, for example, cannot be added together as can kilograms. The combination of two noises with average levels of 60 dB does not give a sound pressure level of 120 dB, but 63 dB.

The addition of a noise with a level of 70 dB to a room with a level of 80 dB will result in no measureable difference in the overall level. This does not mean, however, that a large number of secondary sources can be introduced into an environment without increasing the overall level. If ten ‘negligible’ 70 dB noise sources are combined with one 80 dB noise source, the resulting level will be 83 dB. Fortunately in building acoustics, there is seldom a need to combine noise levels in this way or to do many complicated calculations with decibels or other logarithmic units. These examples merely emphasize the peculiarities of the decibel scale.

1.3 FILTERS AND SPECTRA

The pressure variations associated with many sounds have a repeating pattern. This is especially true of musical sounds. The frequency of a repetitive or periodic phenomenon is the number of times per second that the pattern repeats itself. High frequency or high-pitched sounds are heard when the pressure variations in the air occur rapidly-several thousand times per second. The unit used for frequency is hertz (Hz). Thus a musical note with a frequency of 1200 Hz has a fundamental pattern of pressure variations that repeats itself 1200 times per second. In building acoustics,

it is important to know the frequencies which make up a sound because different frequencies behave differently.

Typical sounds in buildings are complex without any clearly defined pattern, and are usually classified as noise. There is usually no obvious frequency or tone associated with such noises, although there may be tonal characteristics such as 'rumbling' or 'hissing'. Despite this, it is possible to analyse noises in terms of the energy contained in certain frequency intervals. This is called spectral analysis.

A narrow band spectrum shows the energy present at each frequency in great detail. Figure 1.2(a) shows the repeating time pattern of a sound source and its corresponding narrow band spectrum. This kind of information is very useful in some instances but more often the detail is overwhelming; in building acoustics it is common to present spectra in standard one-third-octave band or even octave band plots. The term octave has the same meaning in building acoustics as it does in music; adjacent octave bands have frequencies that differ by a factor of two. Adjacent one-third-octave bands are one-third of an octave apart. To produce this kind of spectrum the energy in specified regions of the narrow band spectrum is added together to give the octave or third-octave level. This type of presentation gives information that is easier to relate to the response of the ear. Figures 1.2(b) and (c) show the third-octave and octave band spectra obtained from the narrow-band spectrum in Figure 1.2(a).

In Figure 1.2, the horizontal axis represents the particular frequency or the frequency band of the noise. The vertical axis represents the sound pressure level or energy at the given frequency or frequency band.

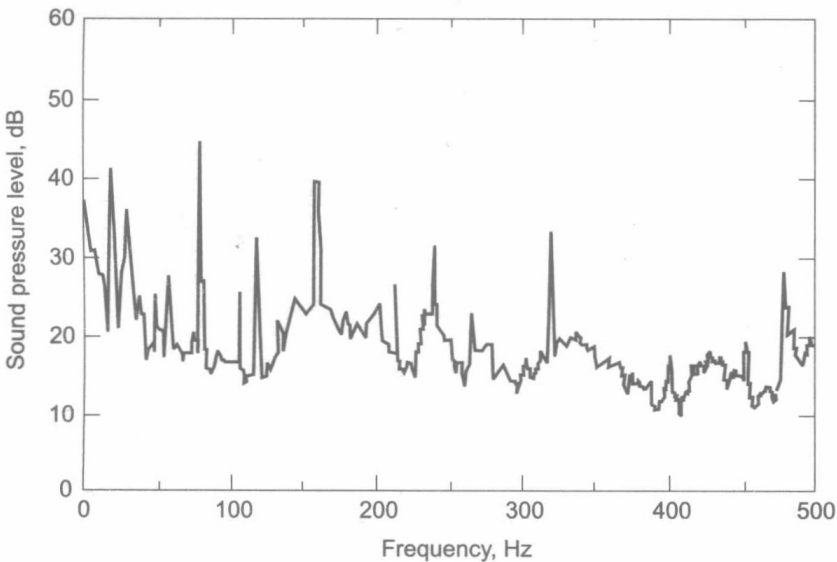


Figure 1.2(a)

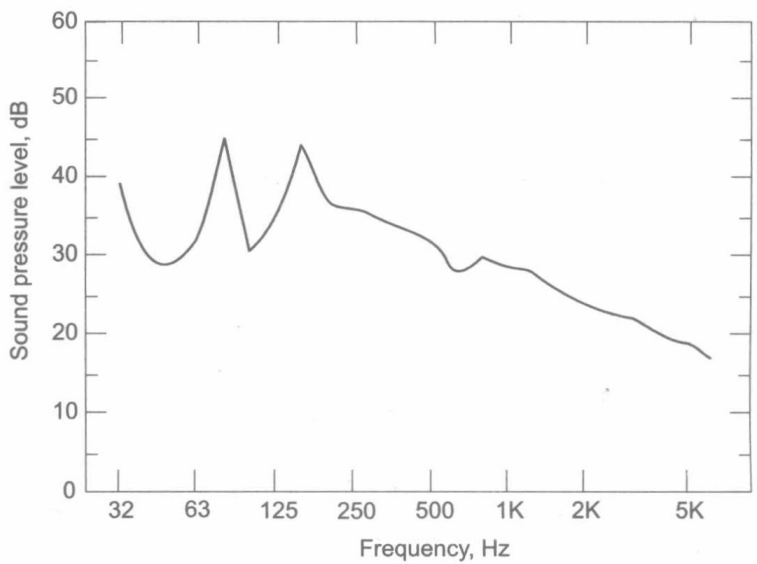


Figure 1.2(b)

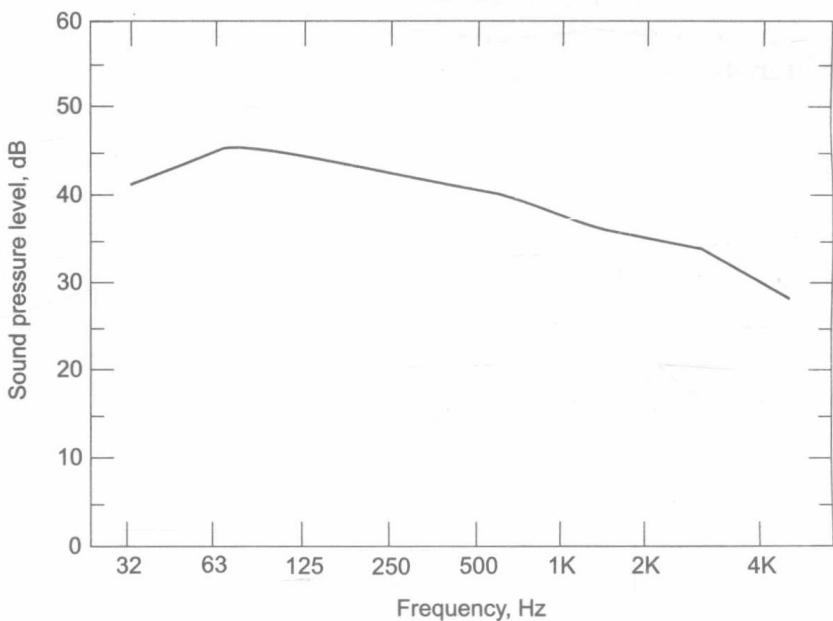


Figure 1.2(c)

The one-third-octave band spectrum for a particular noise source provides a good deal of information but a single number rating is often more convenient. One way of obtaining a single number describing a complex noise is to use A-weighted levels. The human ear is not equally sensitive at all frequencies; sounds of the same level but with different frequencies will not be considered equally loud. A sound at 3 kHz at a level of 54 dB, for example, will sound as loud as one at 50 Hz at a level of 79 dB.

The dashed curve in Figure 1.3 shows the idealised response of the human ear at intermediate sound levels. The solid curve approximates the response of the ear and is called the A-weighting curve.

The output of a microphone or sound level meter can be altered using an A-weighting electrical filter so that it more closely represents the response of the human ear. The resulting sound pressure levels are expressed as a number followed by the symbol dBA.

Noises with identical A-weighted levels can have quite different spectra and can evoke quite different responses from people. The use of such pejorative terms as whine, rasp, grate, rumble and hiss to describe sounds shows that people are well aware of the differences in spectral content. Other terms in common use such as loudness, noisiness and annoyance are not at all synonymous, nor clearly related to sound pressure levels. Despite the shortcomings of this simplistic method of rating noises, it is in common use.

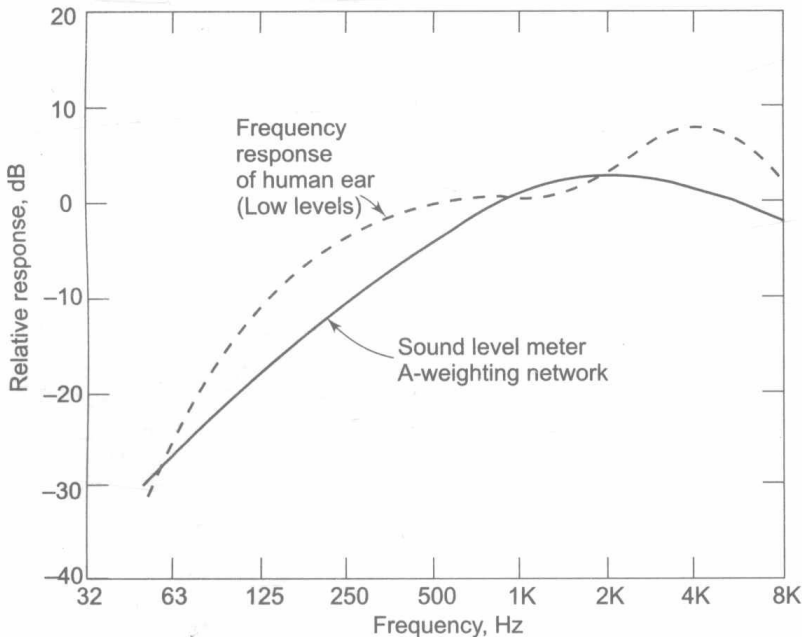


Figure 1.3

1.4 NOISE CRITERIA CONTOURS

Another method of describing the noise in buildings uses a set of octave band contours known as Noise Criteria or NC contours. In India, these are commonly used in Heating, Ventilating and Air Conditioning (HVAC) work and in other areas of building acoustics to specify maximum sound pressure levels in rooms. They provide a convenient way of rating the noise level, and to some extent, the spectrum in a room. Figure 1.4 shows two examples of

how they are used. The spectrum for the sound of interest is drawn on the same graph paper as the NC contours. The point where the spectrum touches the highest NC curve, determines the NC rating for the spectrum. Estimates are made when the spectrum falls between the NC contours shown. Two spectra can have the same NC value but quite different shapes. Although the relationship between the A-weighted level and the NC number will depend on the actual spectrum, usually the A-weighted level is about 7 dB greater than the NC value. NC contours do not describe the spectrum of a neutral sounding noise to be sought after as a design goal. In fact, they have been described as 'both rumbly and hissy'. Background noise spectra with less low and high frequency energy are usually found to be less objectionable.

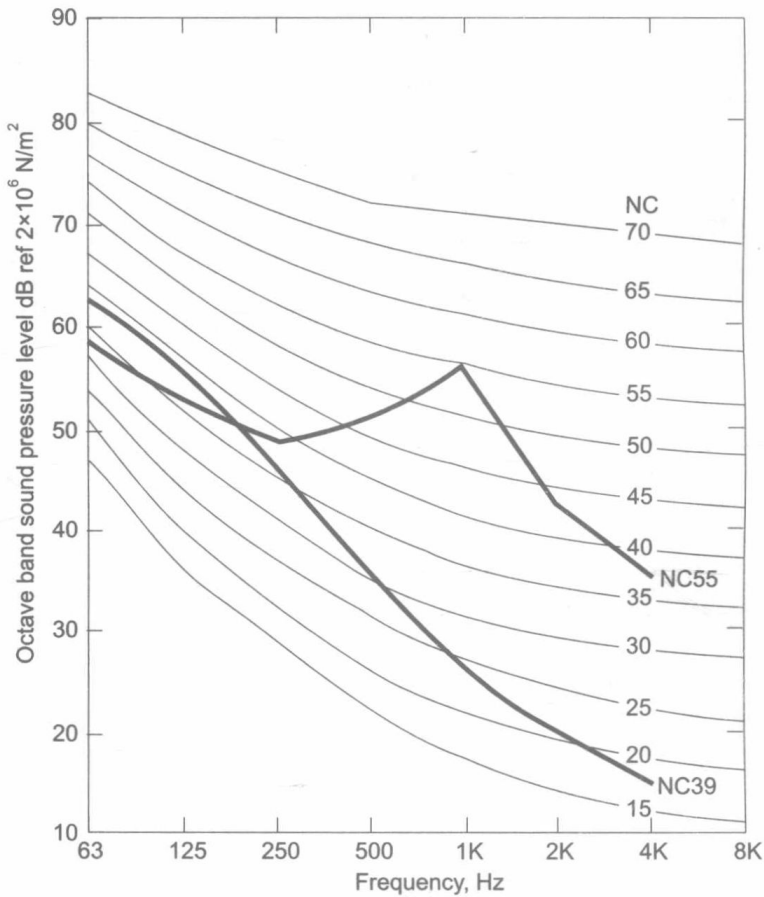


Figure 1.4

Recent issues of the ASHRAE guide include RC contours, which are intended to represent well-balanced, neutral sounding spectra. These ratings, meant to replace the NC contours and to give some indication of the acceptability of the background sound, are beginning to be used more widely in India. Despite this new system, more research needs to be done