

Water Treatment Specification Manual

Frank Rosa

Water Treatment Specification Manual

Frank Rosa

*Field Engineer, Metropolitan Refining Company,
Long Island City, New York*

McGRAW-HILL BOOK COMPANY

**New York St. Louis San Francisco
Auckland Bogotá Hamburg Johannesburg
London Madrid Mexico Montreal New Delhi
Osaka Panama Paris São Paulo Singapore
Sydney Tokyo Toronto**

Library of Congress Cataloging in Publication Data

Rosa, Frank.

Water treatment specification manual.

Bibliography: p.

Includes index.

1. Feed-water—Purification. 2. Heating.
3. Air conditioning. I. Title.

TJ379.R67 1985 697 85-5215

ISBN 0-07-053606-6

Copyright © 1985 by McGraw-Hill, Inc. All rights reserved.
Printed in the United States of America. Except as permitted
under the United States Copyright Act of 1976, no part of this
publication may be reproduced or distributed in any form or by
any means, or stored in a data base or retrieval system, without
the prior written permission of the publisher.

1234567890 DOC/DOC 898765

ISBN 0-07-053606-6

*The editors for this book were Joan Zselezky and
Lester Strong, the designer was Elliot Epstein, and
the production supervisor was Teresa F. Leaden. It was
set in Century Schoolbook by Progressive Typographers.
Printed and bound by R. R. Donnelley & Sons Company.*

Preface

The objective of this book is to provide consulting firms, professional engineers, mechanical contractors and direct clients with the means for solving water treatment problems, while at the same time using minimal chemistry to illustrate its points.

Up till now, design engineers wanting sets of specs and drawings for projects requiring water treatment had to utilize sets already existing, altering them to meet the new conditions. The engineers may have also contacted water treatment firms to supply specifications for the proposed projects, which guidelines in all probability were very specific and tended to limit the engineers to the use of particular programs and at times unique chemical feed equipment unavailable elsewhere. But with the help of this book design engineers can now specify nonproprietary water treatment programs for clients and feel confident, if the specs are met, that the clients will be pleased. The drawings used to illustrate the manual, based on extensive field experience, try to eliminate those water treatment call-back problems that can sour engineer-client relationships.

For mechanical contractors, this work will help trace water treatment problems on troublesome jobs — that is, will help answer questions such as “Why are the heat pump coils plugging?” or “Why is a particular water treatment feed system not suitable for this project?”

Plant managers or physical plant directors for educational facilities can use this work to solve boiler flooding problems, upgrade chemical feed equipment, or publish a set of specs for comparative bidding on water treatment projects for the facility.

This manual can be effectively used in schools that teach HVAC courses since it is devoid of chemical terms which tend to confuse the HVAC and mechanical engineering student. Students in the HVAC field understand plumbing, pressures, thermodynamics, and associated HVAC terms. However, it is unlikely they will know the differences between phosphonic and phosphoric acids or will even care to know them. The HVAC student is interested in why a problem occurs, *not* in chemical terms but in terms that can be related to. For example, on finding a condenser loaded with lime, will HVAC technicians want to hear that the unit scaled up because the

solubility limits of the carbonates of calcium and magnesium were exceeded, and this, compounded by high alkalinity, caused the carbonate salts to layer on the heat exchange surfaces of the condenser? Or will they want to know that the unit plugged because of insufficient bleed-off?

The reader will note that this work is devoid of references to specific products manufactured by water treatment firms. It was felt that their inclusion would take away rather than contribute to the value of the book. The engineers consulted during its writing felt there were enough puff works available without adding another.

The author is indebted to the following for assistance and inspiration: Mr. Michael H. Johnson, plumbing designer for a major northeastern architectural firm, for his help in making the author's drawings suitable for publication.

The late Messrs. T. T. Peck, C. F. Schweizer, and W. J. Covney for the fine examples they set.

Clients, past and present, for allowing the author to run tests on their equipment.

Central New York ASHRAE members for their advice and encouragement.

Central New York consulting engineers for their repeated urgings to get this work published.

The entire staff at Metropolitan Refining Company, Inc., for the experience the author has gained there since 1969.

To Master Efrain J. Rosa for spotting numbering errors in the drawings.

Frank Rosa

Contents

Preface ix

ONE Water Treatment Justification 1

Open Recirculating Water System 1
Domestic Water Treatment 12
Steam Boilers 20

TWO Closed Systems 31

Cleaning Closed Systems 32
New Closed Recirculating Water System and Cleaning It 55
Treatment for Closed Systems 58

THREE Open Systems 63

Treatment of Open Systems 63
Once Through Systems 71
Open Recirculating Water Systems 75

FOUR Algaecides/Biocides 113

The Problem 113
Controlling the Problem 115

FIVE Steam Boilers 123

Water Analysis 123
Boiler Systems and Water Treatment Programs 125

SIX Domestic Water Treatment 153

Soft Supply 153
Hard Supply 157
Very Hard Supply 159
Variable Supply 162
Water Softening 165

SEVEN Chemical Safety 171

Air Conditioning Systems 172

Steam Boilers 177

Cleaning Compounds 180

EIGHT Water Treatment Specifications for Existing Buildings 185

Establishing Viable Water Treatment Specifications 185

"Gadgets" 190

References 193

Product Directory 195

Bibliography 201

Index 203

Water Treatment Justification

This chapter provides guidelines that will enable the reader to choose a heat rejector based on sound principles. When does one opt for an air-cooled condenser vs. a water-cooled unit? Which chemical feed system is best? Although many factors must be taken into consideration in choosing a particular heat rejector, the reader or design engineer should not overlook a prime parameter—the quality of the water supply! Let us analyze the water quality for each system under consideration and strive to use the information gleaned here in the decision-making process.

OPEN RECIRCULATING WATER SYSTEMS

The primary factor in choosing a water-cooled vs. an air-cooled condenser should be the quality of the water supply. However, design engineers are often confused by the term “quality” as it is applied to recirculating water systems. As used here, this term describes the ramifications of using the water for a particular purpose. For example, a water supply may be of excellent quality for drinking purposes but be of very poor quality for process use. In open recirculating water systems, one is concerned with those parameters which will impede heat transfer and thus affect heat-rejecting efficiency. The parameters of concern are *hardness*, which must not exceed 1200 parts per million (ppm) as calcium carbonate; *alkalinity*, which must not exceed 500 ppm as calcium carbonate; and *silica*, which must not exceed 150 ppm. These are the maximum parameter limits, and to exceed them invites problems. This is not to say that one will not experience problems as long as one does not exceed the maximums. Rather, as a primary analytical tool, one should take these parameters into consideration. Since the author does not intend to burden the reader with many chemical terms or formulas, the reader is urged to review other works on the subject.^{1,8,9} However, the author does not feel that knowledge of chemistry is essential to the design engineer, just as a knowledge of mechanical engineering is not needed to operate an automobile. One need only understand that certain parameters are not to be exceeded to design successful water treatment facilities.

Let us now analyze some water supplies and examine their use in open recirculating water systems.

2 Water Treatment Specification Manual

CASE 16300

Parameter	Values	
	City	Softener ¹
pH	7.7	7.8
Alkalinity, ppm as CaCO_3	215.0	225.0
Total hardness, ppm as CaCO_3	705.0	0.0
Silica, ppm as SiO_2	7.0	7.0
Chloride, ppm as NaCl	18.0	78.0*
Total dissolved solids (TDS) by conductance, ppm	607.0	819.0

* The apparent discrepancy in the value of salt, sodium chloride (NaCl), in the city supply is not an analytical error. The author brought this to the attention of the water softener mechanic and was informed that since the softener was delivering soft water, it was functioning satisfactorily. Rebuilding the valves had no effect on the results, nor was the seller of any help. The author acknowledges that something was wrong, but the owners expressed no concern.

It is evident that the limiting factor in the use of the city water is the hardness, or $1200/705 = 1.7$ cycles. Should the concentration of the water in the recirculating system become more than 1.7 times that of city water, then scale, or lime, on the heat-exchanger surfaces will be a certainty! Alkalinity ($500/215 = 2.3$), though high, and silica ($150/7 = 21.4$) do not enter as factors unless their maximums are exceeded.

Let us now consider the ramifications of operating a centrifugal machine of 100-ton cooling capacity with a minimal chemical feed and bleed-off system; see Fig. 1. To achieve a scale-free operation for the condenser, we must provide a bleed-off rate in excess of the maximum system load (see Fig. 42). Thus, a continuous bleed-off rate of 4.5 gallons per minute (gal/min) must be maintained. We cannot assume a bleed-off rate of 2.2 gal/min, a 50 percent load, adequate with this supply; we must provide for bleed at the maximum anticipated load! At a continuous bleed-off rate of 4.5 gal/min, we drain 6480 gal of water as bleed and evaporate, at an actual 100 percent load, 320 gal for a total daily consumption of 10,800 gal of water!

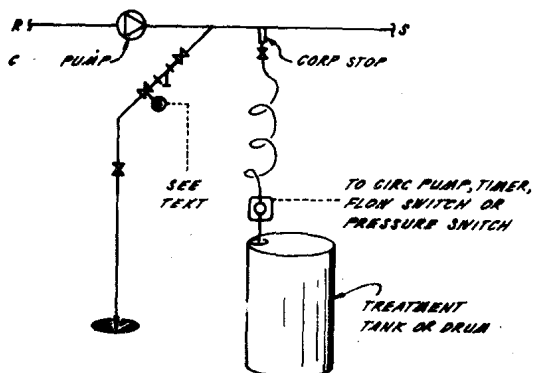


FIGURE 1 Simple chemical feed system.

If soft water were used as make-up water and provisions were made for alkalinity reduction and acid feed, one could reduce water consumption by operating at higher cycles or so one could be led to believe. Referring to Langelier's saturation index (often abbreviated as LSI, or simply SI) in Fig. 2, let us look at two approaches — 10 cycles with no bleed-off and 7 cycles with a bleed-off of 0.5 gal/min.

10 Cycles of Concentration

Let us add to the known facts that we have a mechanical draft cooling tower with 0.2 percent windage drift and a recirculation rate of 300 gal/min for the 100-ton system. At 10 cycles we would require a bleed-off rate of 0.33 gal/min to maintain the stated concentration of solids in the system. However, since the cooling tower has a built-in bleed-off rate of 0.6 gal/min (the 0.2 percent windage drift), bleed is not required, or so our calculations would lead us to believe. However, let us play it safe and maintain a 0.33-gal/min bleed rate and look at the tower water at 10 cycles:

pH	Being kept at 7.2 to 7.4
Alkalinity	Being kept at 40 to 45 ppm as CaCO_3
Hardness	Softener keeping it at 1.0 ppm so we concentrate to 10.0 ppm
Silica	Climbs to 70 ppm
Chlorides	Climbs to 180 to 780 ppm*
TDS	Climbs to 8190 ppm
Sulfates as Na_2SO_4	3122 ppm due to acid use
Langelier's saturation index	-1.60 ₆ at 7.4 pH at 140°F (60°C) skin temperature

From the above, clearly at 10 cycles we would wind up with a very corrosive water, -1.60₆, containing sufficient chlorides and sulfates to challenge any corrosion inhibitor. Furthermore, the use of bio-degradable organic corrosion-inhibitor systems along with the sulfates could lead to problems with bacterial slime or the growth of acid-producing bacterial species. We could hope to control them with algacides, but would soon be plagued with a strain resistant to the conventional attack and then chlorine, at 50 to 100 ppm, would have to be used.

7 Cycles of Concentration

At this 7 cycles of concentration we would require a bleed-off rate of 0.5 gal/min to maintain conditions as stated. The water, at this level, will appear as follows:

pH	Being kept at 7.2 to 7.4
Alkalinity	Being kept at 40 to 45 ppm as CaCO_3

* Theoretically, the chlorides should be 180 ppm, but they will be 780 ppm as long as the water softener maintains a 78-ppm constant feed.

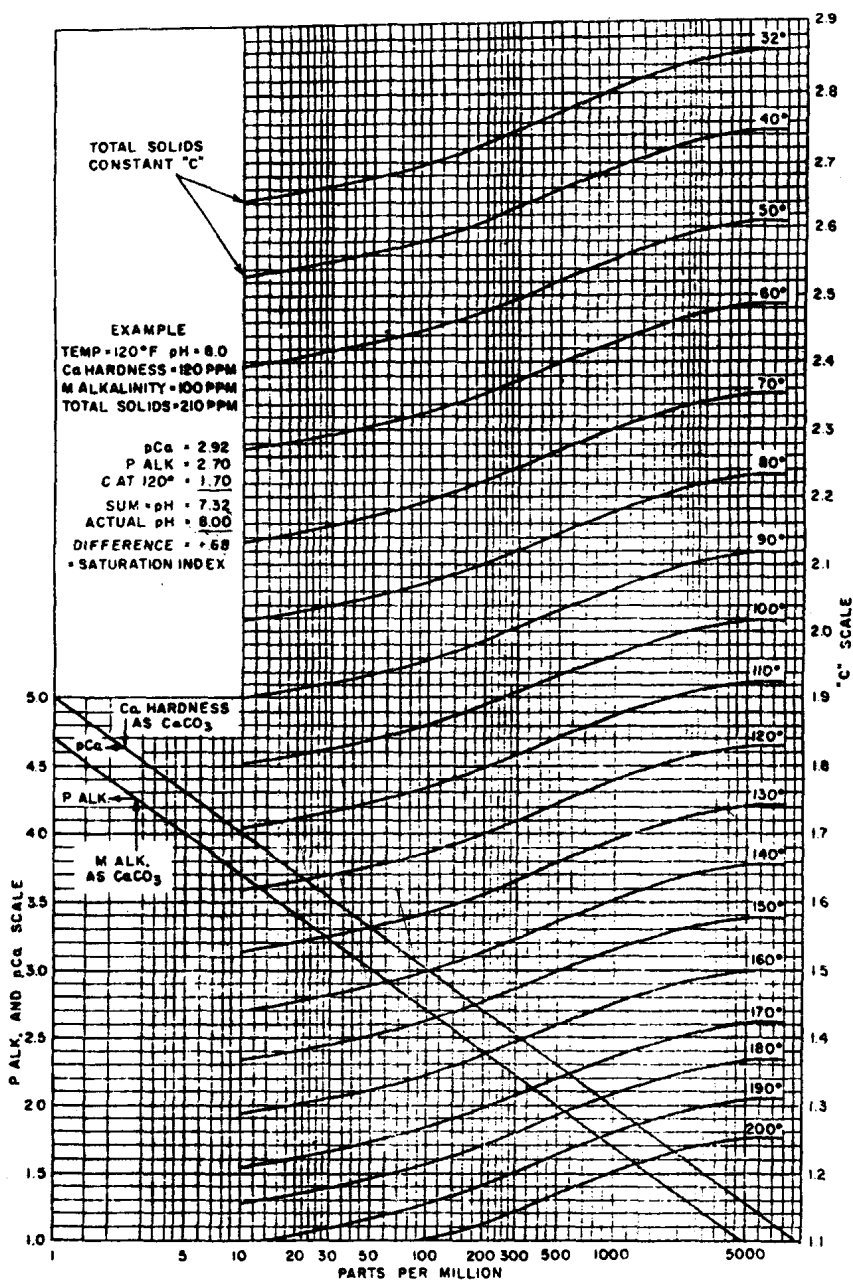


FIGURE 2 Langelier's saturation index I_s . (From Sheppard T. Powell, *Water Conditioning for Industry*, McGraw-Hill Book Company, New York, 1954. Used courtesy McGraw-Hill Book Company.)

Hardness	Concentrates to 7.0 ppm
Silica	Climbs to 49 ppm
Chlorides	126 or 546 ppm as NaCl
TDS	5733 ppm
Sulfates	2172 ppm as Na_2SO_4
LSI	-1.31 ₆ at 7.4 pH at 140°F (60°C) skin temperature

Even at 7 cycles, clearly there is not too much hope for using this supply as the cooling tower feed. The difference between 10 and 7 cycles is not significant enough to even consider using a water softener. Even as a stop-gap measure, using a water softener would be throwing good money after bad. We would require a softener with a capacity of 200,000 grains per day (gr/day), which would consume about 60 pounds (lb) of salt every time it went into regeneration!

What, then, are the alternatives with this supply? On a contemplated job, the choice should be easy — specify an air-cooled condenser! For an existing job, consider going to a once-through water-cooled system if the switch to an air-cooled condenser is too expensive. With a once-through cooling system, we could consider a threshold-type chemical feed program with, perhaps, a little a.c.d as insurance against scale formation. Figure 3 shows a suggested installation similar to one the author designed for a plant utilizing water on a once-through basis. The baffled mixing tank is constructed in the field out of 12-inch (in) pipe. Note that this is not an installation for a modulated system. When water is required for cooling purposes it should flow at full pipe capacity, and should cease flowing when water for cooling is no longer required.

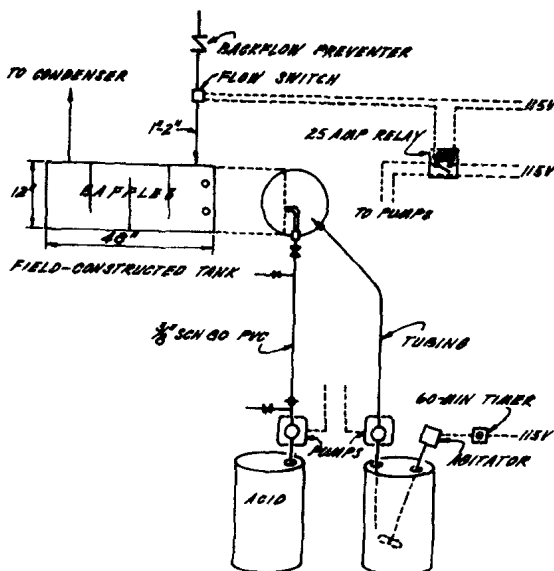


FIGURE 3 Chemical feed for once-through cooling water.

So much for the impossible situation. Now let us consider an acceptable water supply.

CASE 28585

Parameter	Values	
	City	Softened
pH	7.0	7.0
Alkalinity ppm as CaCO ₃	90.0	95.0
Total hardness ppm as CaCO ₃	125	0.0
Silica ppm as SiO ₂	1	3.0
Chlorides ppm as NaCl	17.0	17.0
TDS by conductance ppm	185.0	132.0

Here the limiting factor is the alkalinity ($500/90 = 5.6$ cycles) with hardness close behind ($1200/125 = 9.6$) and silica not even a factor. This supply is satisfactory for an open recirculating water system, but it does pose somewhat of an equipment selection problem for the design engineer at the planning stage. Even though this supply is satisfactory, it will pose a problem because of the alkalinity. Although operation at 5.6 cycles appears to be indicated, without acid prudence dictates otherwise, for a 4.0-cycle maximum without acid would provide a small safety margin. If acid use we could reduce water consumption and operate at 7 cycles with little fear of scale formation.

Let us consider the following, which should assist in the choice of feeding equipment. Use \$1 per pound for the scale and corrosion inhibitor, which will be fed at 100 ppm, and \$0.08 per pound for 60° Baumé sulfuric acid. The tonnage will be the same as previously — 100-ton centrifugal machine at 100 percent load at 24 h/day at 182 days.

Parameter		
Cycles	4.0	7.0
Bleed-off, gal/min	1.00	0.50
Total bleed, gal/day	1440	724
Treatment (scale/corrosion inhibitor) lb	1.2	0.6
Sulfuric acid lb	0	2.6
Daily cost	\$1.20	\$0.81
× 182 days	\$218.40	\$147.42
+ Water at \$0.90 per 1000 gal	\$236.04	\$118.59
Total	\$454.44	\$266.01

As can be seen, there is a slight benefit in the use of acid for alkalinity control — a 48 percent savings in treatment cost and a reduction in water use of 716 gal/day. Is it cost-effective to sell the client on an acid feed system, given the above figures? The author would be hard-pressed to do so, considering the added cost of the acid feed pump.

and tank, about \$600. However, as insurance against scale formation [a layer of scale the thickness of a dollar bill (0.060 in) increases energy consumption by 53 percent¹⁰], the use of a cold is advised with this supply. The following should help to clarify the point.

$$\begin{aligned}
 &100\text{-ton centrifugal machine} \times 1.0 \text{ kW/ton} \times 24 \text{ h} \\
 &\quad \times 182 \text{ days} \times \$0.04 \text{ per kWh} = \$17,472.00 \\
 &\quad \text{Scale layer of 0.060} = \$26,732.00 \\
 &\quad \text{Net waste} = \$9,260.00
 \end{aligned}$$

The above is not a complete case history. It is only meant to show that other factors need to be taken into consideration when you attempt to justify specific chemical feed equipment. On the surface, case 28585 does not show a definite need for acid. But as insurance, the added one-time cost is insignificant compared with the potential added energy costs resulting from scale formation on the heat exchanger.

The following case involves such an excellent supply that it can almost be used without bleed-off.

CASE 47348

Parameter	Value	Cycles
pH	7	
Alkalinity, ppm as CaCO_3	30.0	$500/30 = 16.7$
Total hardness, ppm as CaCO_3	42.0	$1200/42 = 28.6$
Silica, ppm as SiO_2	2.7	$150/2.7 = 55.6$
Chlorides, ppm as NaCl	2.9	
TDS (by conductance), ppm	55.0	

This is an excellent supply for an open recirculating water system. A calculation of the limiting factors reveals that we can operate a spray pond or an atmospheric tower with little, if any, bleed-off at 15 cycles. The following tabulation shows the requirements for each type of heat rejector.

100-ton Refrigeration at 100 Percent Load

	Heat rejector			
	Spray pond	Atmospheric tower	Mechanical draft tower	Evaporative condenser
% Windage drift	1.0	0.3	0.1	0.0
Windage drift, gal/min	0	0.3	0.1	0.05
Bleed-off * 15 cycles	0.2	0.2	0.2	0.2
25 cycles	0.13	0.13	0.13	0.13

* The bleed-off calculated from $B = E/C - 1$ where C = cycles and E = evaporation is taken as 3 percent of tonnage in gallons per minute. The use of $E_{\text{gal/min}} = \text{tonnage} \times \text{heat rejection factor} \times 24 / (1050 \text{ Btu/lb})$ will provide a much more accurate figure.

The mechanical draft tower and evaporative condenser, owing to their minimal windage drift, would require additional water loss, bleed-off, to maintain 15 cycles. With a little acid to neutralize alkalinity, we could conceivably operate at 25 cycles. At this range the only heat rejector that would require bleed off would be the evaporative condenser, since its windage drift is only 0.05 gal/min.

How important is this ability to read an analysis? Let us take the following case and analyze our options:

Known: A 3000-ton refrigeration load with a mechanical draft tower operating a 100 percent load at 24 h/day. Use 0.03 gal/(min · ton) as an evaporation factor.

Limit: The authorities will not allow more than 1000 gal/day to be dumped from the system.

Options

	Cycles		
	10	15	25
Wind drift, gal/min	3.0	3.0	3.0
Bleed off, gal/min	10.0	6.43	3.75
Net loss, gal/min	7.0	3.43	0.75
Net loss, gal/day	10,080	4939	1080
Cost/day*			
Scale/corrosion inhibitor	12.00	8.00	4.75
Acid	0	0	3.17

* Inhibitor is fed at 100 ppm at \$1.00 per pound with acid at \$0.08 per pound.

A casual inspection of the water analysis, case 47348, would lead us to believe that acid is not required. However, when confronted with the 1000-gal/day maximum waste limitation, do we inform the client that the project is not feasible? An in-depth analysis would reveal that by going to 25 cycles and using an easily maintained sand filtration system, a water-meter-activated chemical and acid feed system with a tower capable of a slightly higher windage drift, we could satisfy the limiting criteria.

So far we have covered an impossible supply, an acceptable supply, and an excellent supply, all of which had one thing in common — *consistency!* Let us now examine and address the problem of the variable supply, the scourge of water treatment firms and thorn in the side of design engineers.

Figure 4 lists analytical results of a central New York municipal water supply covering the 1981 to 1983 air conditioning season. How can one propose to treat this water in an effective manner if one is not aware of the nature of the supply? If one were to accept the results of a springtime analysis as representative of the supply, for example, one dated April 20, 1982, one would be hard-pressed to explain to the operators why the heat

FIGURE 4 Analytical results of domestic water, city of Ithaca, NY, 1981, 1982, 1983

Date	1981	5/11	5/18	5/26	6/1	6/9	6/15	6/16	6/22	6/29	7/6	7/13	8/17
pH		7.5	7.5	7.6	7.3	7.2	7.5	7.4	7.1	7.4	7.4	7.0	7.2
M alkalinity, ppm as CaCO ₃	75	85	80	90	85	90	105	100	115	125	100	110	110
Hardness, ppm as CaCO ₃	98	104	104	114	112	114	128	120	140	136	124	130	130
Silica, ppm as SiO ₂	4.0	4.0	3.2	4.0	3.4	3.0	5.0	4.4	6.0	6.0	5.3	7.0	7.0
Sodium chloride, ppm	41	35	35	35	29	32	38	35	52	46	35	41	41
TDS by meter, ppm	154	154	159	121	148	150	149	154	174	180	167	169	169
Date	1982	4/20	5/7	5/13	5/14	5/19	5/24	6/2	9/22	9/28	10/5	10/13	
pH		7.4	7.4	7.7	7.3	7.4	7.2	7.6	7.4	7.6	7.6	(6.8)	
M alkalinity, ppm as CaCO ₃	60	95	100	80	95	110	110	115	130	140	130	135	
Hardness, ppm as CaCO ₃	90	102	120	112	130	142	142	170	152	184	188	188	
Silica, ppm as SiO ₂	5.0	3.8	5.0	...	4.2	(25)	4.0	5.0	5.0	5.0	4.0	4.0	
Sodium chloride, ppm	35	35	29	41	35	41	35	47	41	35	41	41	
TDS by meter, ppm	113	139	173	132	145	187	196	197	203	185	202	202	
Date	1983	5/2	5/9	5/20	5/30	6/10	6/21	6/30	7/6	7/11	7/29	8/12	
pH		(8.4)	(8.3)	7.4	7.1	7.4	7.7	7.8	7.6	7.8	7.5	7.2	
M alkalinity, ppm as CaCO ₃	55	70	70	90	105	110	110	115	115	125	125	125	
Hardness, ppm as CaCO ₃	70	100	120	108	275	144	130	140	135	154	148	148	
Silica, ppm as SiO ₂	4.0	(40.0)	14.	4.1	3.1	2.0	4.0	5.0	4.6	5.0	4.9	4.9	
Sodium chloride, ppm	17	23	23	35	29	41	29	41	41	26	47	47	
TDS by meter, ppm	103	124	134	167	162	164	178	197	179	191	185	185	

NOTE: Figures in parentheses indicate possible analytical error. All figures are for the city of Ithaca, NY.

rejector or exchanger was loaded with lime at season's end. If one had based one's recommendations on a summer analysis, say, one dated August 17, 1981 and supplied an acid-based treatment, then the pH would have taken a nose dive during the spring months. Figure 74 is a graphical representation of the alkalinity during the period of observation, and it illustrates the difficulties involved in setting up a proper water treatment program. Thus the reason for stressing that when a set of water treatment specifications is put together, the onus of responsibility should fall on the water treatment firm. The hardness was not graphed because it does not have as significant an impact as does the change in alkalinity.

How would we attack the problem of a variable water supply? First, and foremost, we obtain a history of the water. Hopefully the local water authorities can supply it; if not, then a few calls to others using the supply can produce analyses provided by their water treatment firms. For this particular supply (Fig. 4), the author would insist on nothing less than a water-meter-activated chemical feed system, a pH controller/recorder for acid feed, and the maintenance of the concentration at 6 cycles, not higher! With small systems under 100 tons, to operate at higher than 3.0 cycles with a simple chemical feed/bleed system (Fig. 1) is to risk scale formation and an inefficient operation.

At what stage does one insist on a pH controller? The design engineer must make this decision based on payback, cost of treatment chemicals, and cost and availability of the water supply. Figure 5 provides some guideline data. In each case, the difference between using acid and not using acid is 38 percent. However, with a cost factor of \$1000 for an acid pump and a pH controller, the payback is 6 years for the 200-ton unit and 4 years for the 300-ton unit. The reader should, at this time, study the contents of pages 6 and 7 as they relate costs vs. scale. For the numbers can be misleading. To decide, based on a 5-year payback, not to use acid could be a mistake. Once a unit develops scale, it can cost anywhere between \$600 and \$1000 to remove. This does not take into consideration three factors:

1. Increased energy costs
2. Damage to fan or air-moving components of system
3. Stripping of the galvanizing if an improper acid is used on a galvanized tower or evaporative condenser

There are many facets to water treatment for open recirculating water systems. It involves more than a couple of drums of chemical, more than feeding equipment, more than a choice of water treatment firm. And it is folly to concentrate on one aspect of the system and overlook the impact of the whole.